


## PECAN VALLEY GROUNDWATER CONSERVATION DISTRICT SPACING REQUIREMENTS ON ALL NEW DRILLS

A new well may not be drilled within 50 feet from the property line of any adjoining landowner.

Minimum distance from any existing or proposed septic system, whether on owner's property or adjacent property, must meet county and state standards.

Spacing requirements for permitted wells is 2 feet for every gallon per minute (gpm) of the permitted flow from nearest existing well or authorized well site.

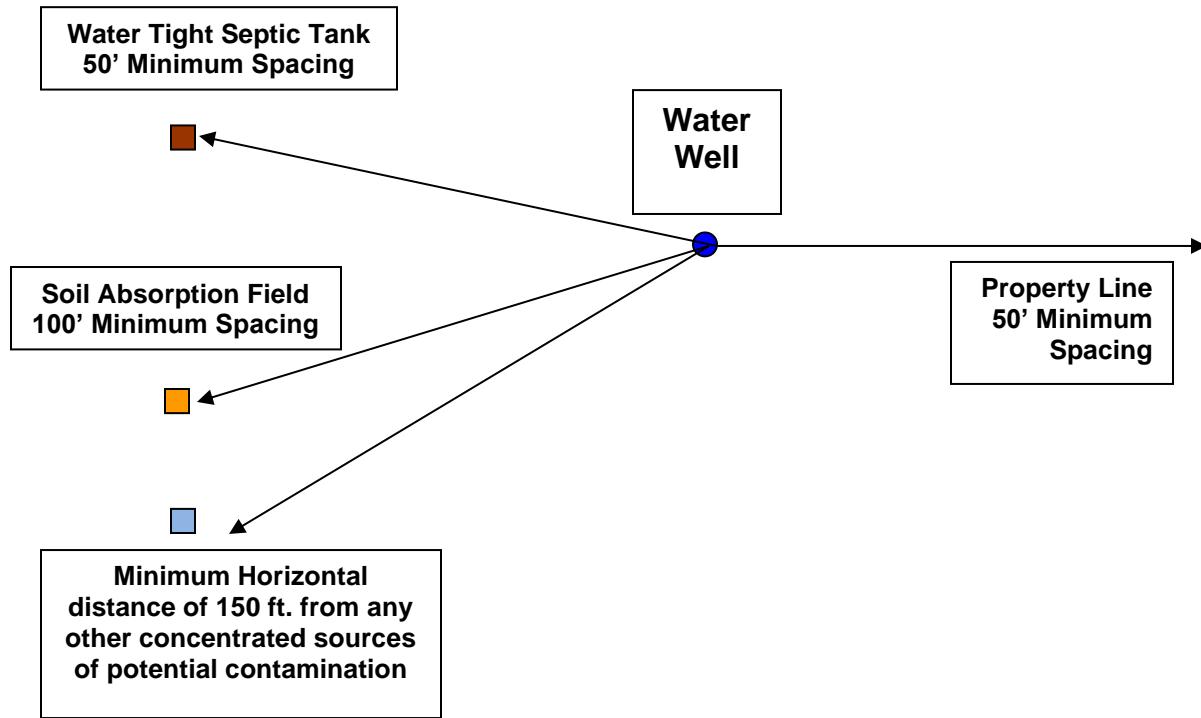

Well must be 100' from the spray radius of the sprinkler heads on an aerobic system.